

PERFORMANCE ANALYSIS AND CONTROL OF 10 KW PERMANENT MAGNET SYNCHRONOUS GENERATOR CONNECTED TO GRID DRIVEN BY WIND TURBINE USING AUTONOMOUS CONVERTERS APPLYING SVPWM TECHNIQUE.

¹SAMRAAT SHARMA, ²SUBIR DUTTA, ³SOUGATA GHOSH, ⁴JYOTI JOSHI,

¹PG Student Department of Electrical Engineering, IFTM University, Moradabad

²Assistant professor Department of Electrical Engineering NIT, Silchar

³Department of Electronics and Communication, IFTM University, Moradabad

⁴Lecturer Department of Electrical Engineering, ASIT, Haldwani

Abstract- The Simulation model of DDPMSG 10KW grid Connected are developed using MATLAB 2013(a) and FAST Simulator. In addition to it SVPWM technique has been applied for 10KW grid connected model. Space vector pulse width modulation has been used for obtaining the output voltage with less distortion. The result so obtained show that there is a degree of freedom of space vector placement in a switching cycle. The fully controlled converter has been used to provide separate control for active and reactive powers. The simulation results in MATLAB SIMULINK 2013a showing the model have good dynamic and static performance.

Keywords- Direct drive permanent magnet synchronous generator, space vector pulse width modulation, fully controlled converters.

I. INTRODUCTION

The aim of this research is to model an autonomous control wind turbine driven permanent magnetic synchronous generator.(PMSG) which feeds alternating current (AC) power to the utility grid. Furthermore, this research also demonstrates the effects and the efficiency of PMSG wind turbine which is integrated by autonomous controllers. In order for well autonomous control, two voltage source inverters are used to control wind turbine connecting with the grid. The generator-side inverter is used to adjust the Synchronous generator as well as separating the generator from the grid when necessary. The grid-side inverter controls the power flow between the direct current (DC) bus and the AC side. Both of them are oriented control by space vector pulse width modulation (SVPWM) with back-to-back frequency inverter. Moreover, the proportional-integral (PI) controller is enhanced to control both of the of the converters and the pitch angle of the wind turbine.

II. INVERTERS AND THE PITCH ANGLE OF THE WIND TURBINE

According to the continuous development of wind power technology, the efficiency of inverter device is facing some tough issues and plays a vital role in the improvement of wind power generation system performance. They need to be enhanced by controller to improve the efficiency and the reliability. Inside them, MPPT integrating with the back to back space vector Pulse width modulation is the advantage of controller, which is used to measure the rotor speed and compare with the calculated optimal rotor speed.

On the other hand, not only does the inverter take an advantage in efficiency control but also the pitch angle controller takes another important part of wind turbine. It is integrated to adjust the aerodynamic torque of the wind turbine when this study rates wind speed.

III. MODEL OF PMSG

Structure of PMSG Wind Turbine. The basic of PMSG wind turbine structure shown on Figure 1 is defined as. The wind turbine generates torque from wind power. The torque is transferred through the generator shaft to the rotor of the generator. The generator produces an electrical torque, and the difference between the mechanical torque from the wind turbine and the electrical torque from the generator determines whether the mechanical system accelerates, decelerates, or remains at constant speed. The generator is connected to a three-phase inverter which rectifies the current from the generator to charge a DC-link V_{dc} capacitor. The DC-link V_{dc} feeds a second three-phase inverter which is connected to the grid through a transformer. Through the control system, the information of wind speed, pitch angel, rotor RPM, and inverter output is accepted to compare with the grid-side data. Therefore, this information is solved by using a digital signal processing. The LCL filter is connected between inverter and Grid to remove the harmonic content in the voltage output. The dc link capacitor is placed between the rectifier and the inverter. The purpose of dc link capacitor is remove the ripples in the dc link voltage and size of the capacitor have to trade of between ripples and response time. D-q axis voltages equations after parks transform

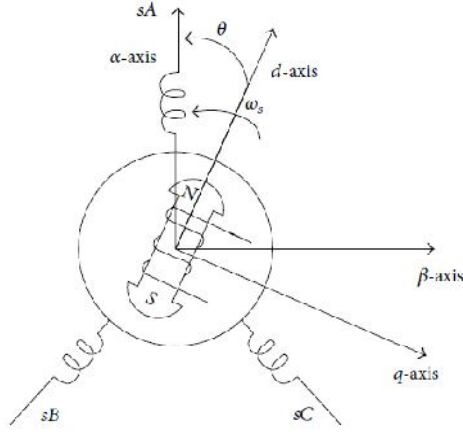


Figure1 DQ axis frame of PMSG

ω_e the frequency of the generator's emf and p is the number of generator pole pairs. voltage equation of the PMSG in dq reference frame.

$$V_d = R i_d - \omega_e L_q i_q + L_d \frac{di_d}{dt} \quad (1)$$

$$V_q = R i_q - \omega_e (L_d i_d + \psi) + L_q \frac{di_q}{dt} \quad (2)$$

The electrical and mechanical angle relation given below, shows the dq-coordinates frame of the PMSG with θ being the angle between d-axis and the main stator axis. V_d , V_q and i_d , i_q are voltages and current of direct and quadrature axis. L_d and L_q are generator inductance

$$\theta_{\text{electrical}} = p \theta_r \quad (3)$$

$$\omega_e = p \omega_r$$

ω_e is the basic electrical angular frequency of the generator. The direct and quadrature axis Voltage by park's transform

$$V_d = R i_d - p \omega_r L_q i_q + L_d \frac{di_d}{dt} \quad (4)$$

The electrical torque is given by

$$\tau_e = \frac{3}{2} p (i_d i_q (L_d - L_q) + \psi i_q) \quad (5)$$

The machine is non salient therefore $L_d = L_q = L_s$ applying in above equation we get.

$$V_q = R i_q - p \omega_r (L_d i_d + \psi) + L_q \frac{di_q}{dt} \quad (6)$$

$$V_d = R i_d - L_s \left(\frac{di_d}{dt} - p \omega_r i_q \right) \quad (7)$$

$$\tau_e = \frac{3}{2} p \psi i_q \quad (8)$$

This are equation of non salient rotor of PMSG.

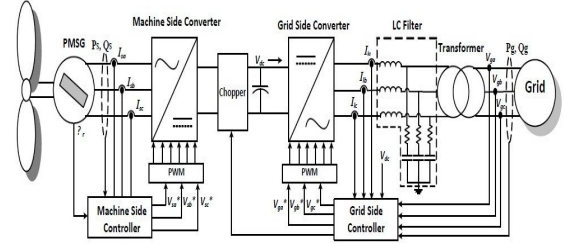


Figure 2 PMSG Complete Control System

It is made of three power electronics equipments

- (a) Rectifier (AC/DC converter),
- (b) Chopper (DC/DC converter)
- (c) Inverter (DC /AC converter)

IV. SPACE VECTOR PULSE WIDTH MODULATION

Three phase voltages

$$v_{AO}(t) + v_{BO}(t) + v_{CO}(t) = 0 \quad (9)$$

Two phase voltages Clarke Transform(α, β)

$$\begin{bmatrix} v_\alpha(t) \\ v_\beta(t) \end{bmatrix} = \frac{2}{3} \begin{bmatrix} \cos 0 & \cos \frac{2\pi}{3} & \cos \frac{4\pi}{3} \\ \sin 0 & \sin \frac{2\pi}{3} & \sin \frac{4\pi}{3} \end{bmatrix} \begin{bmatrix} v_{AO}(t) \\ v_{BO}(t) \\ v_{CO}(t) \end{bmatrix} \quad (10)$$

Space Vector Representation

$$\vec{V}(t) = v_\alpha(t) + j v_\beta(t) \quad (11)$$

$$\vec{V}(t) = \frac{2}{3} [v_{AO}(t)e^{j0} + v_{BO}(t)e^{j2\pi/3} + v_{CO}(t)e^{j4\pi/3}] \quad (12)$$

Where

$$e^{jx} = \cos x + j \sin x \quad (13)$$

$$v_{AO}(t) = \frac{2}{3} V_d, v_{BO}(t) = -\frac{1}{3} V_d \text{ and } v_{CO}(t) = -\frac{1}{3} V_d \quad (14)$$

$$\vec{V}_1 = \frac{2}{3} V_d e^{j0} \quad (15)$$

$$\vec{V}_k = \frac{2}{3} V_d e^{j(k-1)\frac{\pi}{3}} \quad (16)$$

$K=1,2,6$

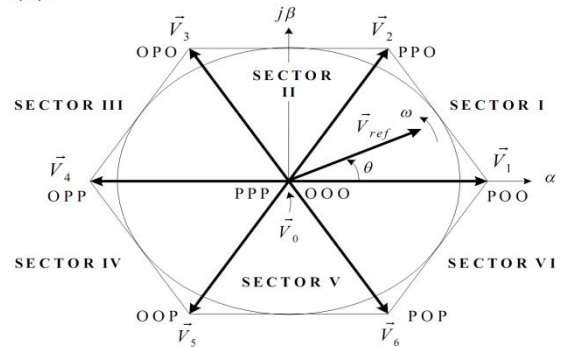


Figure3 Space Vector Modulation

Reference vector V_{ref} Definition

$$\vec{V}_{ref} = V_{ref} e^{j\theta} \quad (17)$$

Rotating in space at ω

$$\omega = 2\pi f \quad (18)$$

$$\theta(t) = \int_0^t \omega dt \quad (19)$$

Dwell time calculation (20)

$$\begin{cases} \vec{V}_{ref} T_s = \vec{V}_1 T_a + \vec{V}_2 T_b + \vec{V}_0 T_0 \\ T_s = T_a + T_b + T_0 \end{cases}$$

T_a, T_b, T_c are dwell times for V_1, V_2, V_0 T_s is sampling period

$$\vec{V}_{ref} = V_{ref} e^{j\theta}, \vec{V}_1 = \frac{2}{3} V_d \vec{V}_2 = \frac{2}{3} V_d e^{j\frac{\pi}{3}} \vec{V}_0 = 0 \quad (21)$$

$$\begin{cases} \text{Re: } V_{ref} (\cos \theta) T_s = \frac{2}{3} V_d T_a + \frac{1}{3} V_d T_b \\ \text{Im: } V_{ref} (\sin \theta) T_s = \frac{1}{\sqrt{3}} V_d T_b \end{cases} \quad (22)$$

$$\begin{cases} T_a = \frac{\sqrt{3} T_s V_{ref}}{V_d} \sin \left(\frac{\pi}{3} - \theta \right) \\ T_b = \frac{\sqrt{3} T_s V_{ref}}{V_d} \sin \theta \\ T_0 = T_s - T_a - T_b \end{cases} \quad (23)$$

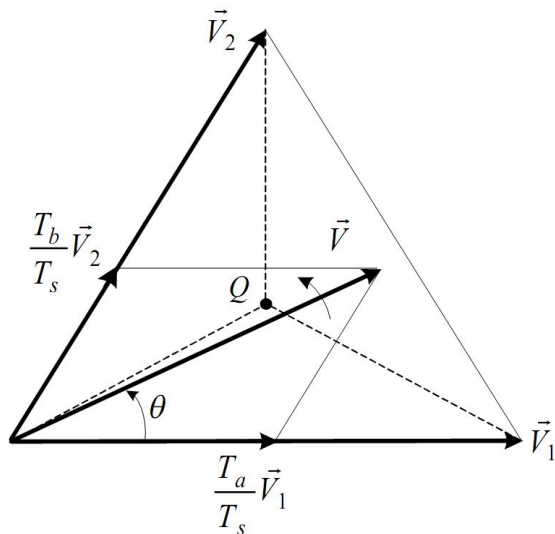


Figure 4 Relationship Between V_{ref} and V_{AB}

Table 1 V_{ref} Location versus Dwell Times

V_{ref} location	$\theta = 0$	$0 < \theta < \frac{\pi}{6}$	$\theta = \frac{\pi}{6}$	$\frac{\pi}{6} < \theta < \frac{\pi}{3}$	$\theta = \frac{\pi}{3}$
Dwell times	$T_a > 0$ $T_b = 0$	$T_a > T_b$	$T_a = T_b$	$T_a < T_b$	$T_a = 0$ $T_b > 0$

V_{ref} is approximated by two active and a zero vectors
 V_{ref} rotates one revolution, V_{AB} completes one cycle
 Length of V_{ref} corresponds to magnitude of V_{AB} .

$$\begin{cases} T_a = T_s m_a \sin \left(\frac{\pi}{3} - \theta \right) \\ T_b = T_s m_a \sin \theta \\ T_0 = T_s - T_a - T_b \end{cases} \quad (24)$$

modulation index

$$m_a = \frac{\sqrt{3} V_{ref}}{V_d} \quad (25)$$

$$V_{ref, max} = \frac{2}{3} V_d \times \frac{\sqrt{3}}{2} = \frac{V_d}{\sqrt{3}} \quad (26)$$

$m_{a, max} = 1 \rightarrow$ Modulation range: $0 \leq m_a \leq 1$

Minimize the number of switching's per sampling period T_s . Transition from one switching state to the next involves only two switches in the same inverter leg.

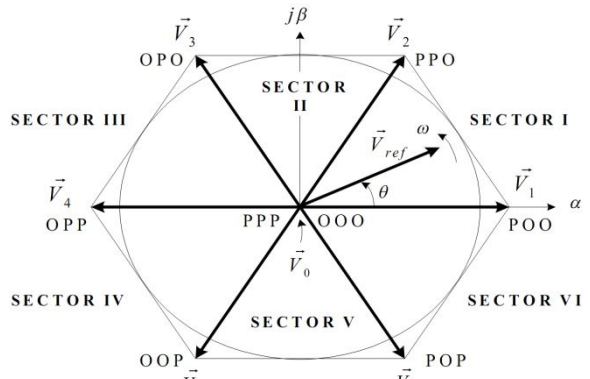


Figure 5 Space Vector Modulation with Sector

Selected vectors: V_0, V_1 and V_2 Dwell times:

$$T_s = T_0 + T_a + T_b$$

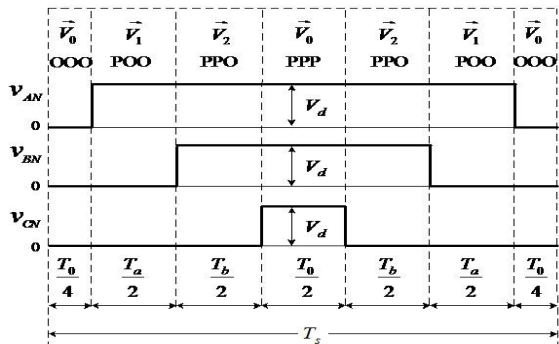


Figure 6 Seven-segment Switching Sequence

Selected vectors: V_0, V_1 and V_2 Dwell times: $T_s = T_0 + T_a + T_b$

Generator-Side Inverter Controller.

The generator-side inverter is controlled to catch maximum power from available wind power. According to (5), in order to control the electromagnetic torque T_e , this study just controls the q -axis current i_{sq} with the assumption that the d -axis current i_d is equal to zero. Furthermore, show that, in order to catch maximum power, the optimum value of the rotation speed is adjusted. The tip speed ratio λ is taken into account due to

$$\lambda_{opt} = (\omega_{ref} R)/v \quad (27)$$

with $E_s = p\omega_r \cdot \psi$ being the permanent flux linkages. The generator-side inverter control schematic is illustrated in Figure 6. Through the MPPT in, the error of ω_{ref} is produced. Therefore, the error of ω_{ref} and ω_s is rescued to PI controller to produce q -axis current component i_q ref which put into space vector pulse width modulation (SVPWM). The d -axis current i_d ref is set to zero because the d -axis current control is adopted. Consequently, through the SVPWM containing voltage feed-forward compensation, the power factors of the generator are calculated and controlled well.

$$V_d = R i_d - L_s \left(\frac{di_d}{dt} - p\omega_r i_q \right) \quad (28)$$

$$V_q = R i_q - L_s \left(\frac{di_q}{dt} + p\omega_r i_d \right) + p\omega_r \psi \quad (29)$$

There, ω_{ref} is the blades angular velocity reference and λ_{opt} is the tip speed ratio optimum.

Grid-Side Inverter Controller

The goal of the grid-side inverter is keeping the stability of the DC-line voltage as well as controlling the active and reactive power. Here, V_d is the d -axis output voltage of the grid, respectively, ω is the angular frequency in electrical degree of grid, R is the resistance, L is the inductance, respectively, and i_d and i_q are the currents of d -axis and q -axis. It is easy to figure out that the current of d -axis and q -axis can be controlled to moderate the active and reactive power. The inner current loop is controlled through PI controller similar to generator side inverter controller. The output voltage loop produces PI controller for calculating the error between V_{dc} and V_{dc} ref to produce i_d ref. Therefore, q -axis current is set to be zero to decoupling control of the active power P and reactive power Q by moderating the d -axis current i_d and the q -axis current i_q .

Pitch Angle Controller.

Pitch angle controller is based on the principle which is changing the blades angle at the revolutions over the maximal generator speed as well as protecting the generator before overloading at high wind speeds. The optimal angle for the wind speed below the nominal value is approximately zero and then it increases with the wind speed. The speed of the generator is

compared with its reference value through PI controller to have the output value of the pitch angle of the blades, which changes the performance coefficient of the turbine.

Maximum Power Point Tracking

In the generator-side inverter, MPPT produces the ω_{ref} for the comparative PI controller. the wind turbine coefficient achieves the maximum for the tip speed, when the pitch angle $\beta = 0$. In terms of every wind speed, there exists a specific point to get the maximum output. Hence, in order to control the maximum power in every wind speed, the MPPT tracks the continuous line and optimal line. The tip speed ratio is kept at constant value for all maximum power points, while the relationship between the wind speed and the wind turbine generator speed is explained as follows:

$$\Omega = \lambda \frac{v}{R} \quad (30)$$

Ω is the optimal rotation wind turbine generator At wind speed V . The MPPT control strategy is based on monitoring the wind turbine generator output power using measurements of the wind turbine generator output voltage and current as well as directly modeling the dc/dc converter duty cycle, which is followed by the comparison of among output power values.

Table 2: Transformer Properties

S. No.	Symbol	10 Kw
1.	V (primary)	90.13 V
2.	V (secondary)	208 V
3.	Nominal power	20 kVA
4.	Series resistance (primary)	0.0043264 Ω
5.	Series resistance (secondary)	8.124*10-4 Ω
6.	Series inductance (primary)	0.574 mH
7.	Series inductance (secondary)	86.198 μ H
8.	Magnetizing resistance	1086.6 Ω
9.	Switching frequency	2.869 H

Table 3: Electrical Model Parameters Parameter.

S. No.	Symbol	10 Kw
1.	Nominal grid voltage	208 V 3
2.	Nominal grid frequency	60 Hz
3.	Nominal PMSG voltage	260 V
4.	C_{DC}	600 μ F
5.	IGBT forward voltage drop	2.0 V

6.	Diode forward voltage drop	1.0 V
7.	IGBT conducting resistance	55 mΩ
8.	IGBT fall time	70 ns
9.	Switching frequency	7 kHz
10.	Transformer turns ratio	1:2.3077 1

TABLE 4 Aeroelastic Model Summary

SNO	Parameter	10 kW Turbine
1	Rotor diameter	7 m
2	Nacelle mass	260.5 kg
3	Nacelle inertia	39.81 kg m ²
4	Generator inertia	0.5 kg m ²
5	Hub inertia	7.71 kg m ²
6	Blade nodes for BEM	15
7	Blade mass	21.7724 kg

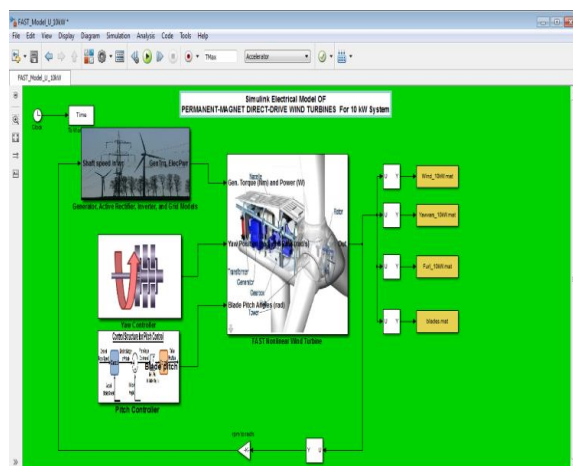


Figure7 Simulation Model of 10 KW of PMDD Wind Turbine.

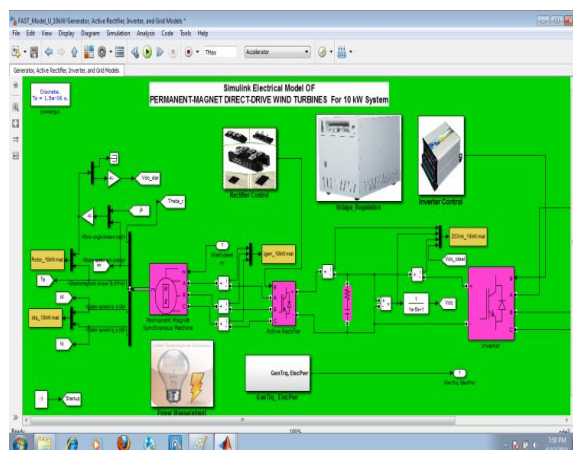


Figure8 Electrical Model For 10KW PMSG Grid Connected

The electrical model consist of PMSG block of 5 MW. Universal bride(Consist of IGBT both generator and inverter side),Rectifier control block ,Inverter control block Power grid block, Voltage regulation block, LCL filter and dc link ,Power calculation and Power GUI block

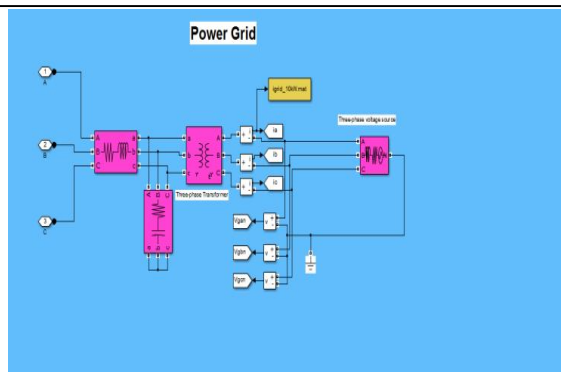


Figure9 Power Grid Block.

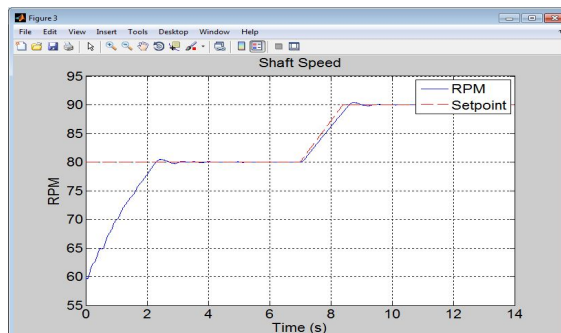


Figure 10 Shaft Speed(10KW)

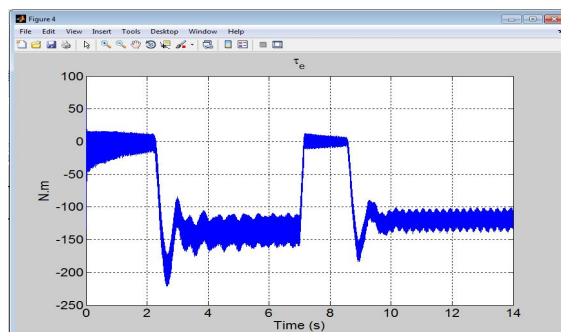


Figure 11 Electrical Torque(10KW)

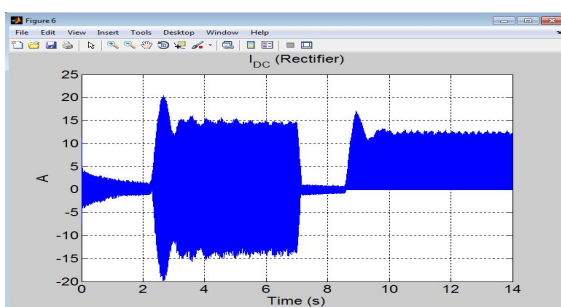


Figure12 Idc(Rectifier) (10KW)

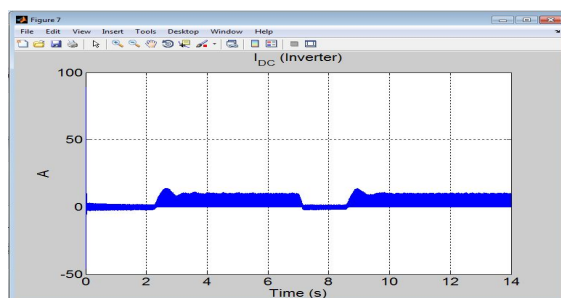


Figure13 Idc(inverter) (10KW)

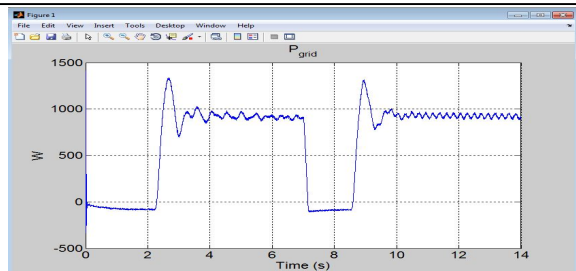


Figure14 ACTIVE_POWER (grid) (10KW)

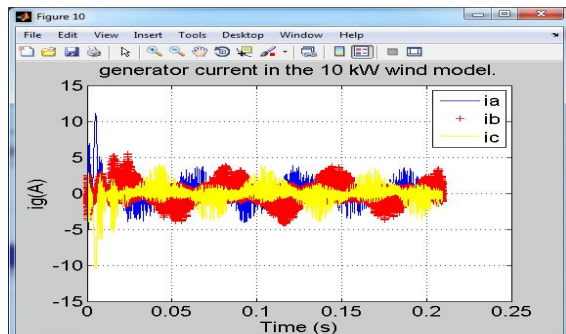


Figure15 I_a, I_b, I_c Stator current from PMSG(10KW)

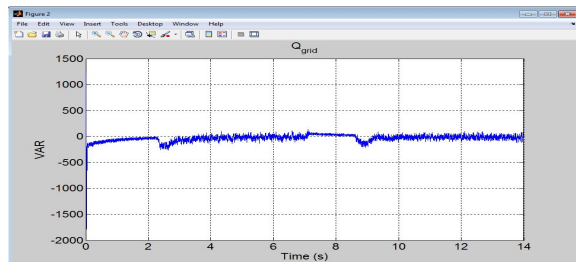


Figure 16 REACTIVE_POWER (grid) (10KW)

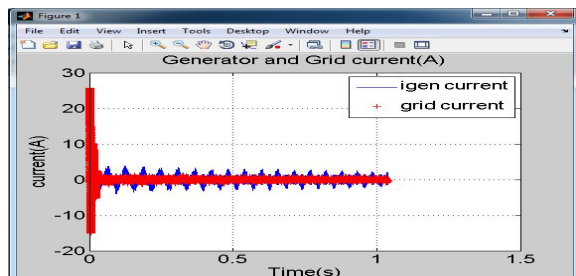


Figure17 Generator and grid current (10KW)

In figure 10 the shaft speed varies from 60 to 90 rpm. In figure 11 the electrical torque is negative. Figure 12 and 13 show I_{dc} of rectifier and inverter. Figure 14 and 16 shows active and reactive power. Figure 15 shows stator current of PMSG. Figure 17 shows generator and grid current.

The figure 14 shows that the reactive power performs the waves of active power and reactive power decoupling control. When the wind turbine catches the wind speed at rate 5m/s, PMSG begins to operate.

Figure 13 shows the waves of DC-link current, the voltage is produced by grid-side inverter and A-phase voltage feeding to the grid. Through the results, it is admitted that DC voltage is well controlled in stabilizing performance with the Fluctuation being

about 25%. Therefore, Pitch angle controller catches the optimum tip speed ratio at 8 and optimum power coefficient at 0.4 through the maximum power point tracking. On the other hand, grid-side inverter models the output voltage with the DC-link voltage in accordance with DC link capacitor. After all, PMSG wind turbine with autonomous control system produces the grid line voltage. In figure 17 generator and grid current are shown. The negative Torque is shown in the figure 11 showing the generating mode.

CONCLUSIONS

This study analyzes the control strategies as well as models and designs of 10KW DDPMMSG wind turbine and simulates the whole autonomous system of PMSG wind turbine feeding AC power to the utility grid in Matlab Simulink 2013a. The simulation results show that the combination of pitch angle controller, generator-side inverter controller, and grid-side inverter controller has good dynamic and static performance. The maximum power can be obtained using SVPWM modulation technique and the generator wind turbine can be operated in high efficiency. DC-link voltage is kept at stable level for decoupling control of active and reactive power. The DC voltage utilization ratio which may be around 71% of the DC link voltage as compared to the conventional sine-pulse width Modulation which is 61.2 % in the linear modulation range. Space vector PWM generates less harmonic distortion in the output voltage or current waveform in comparison to a Sine PWM and it also decreases the harmonic content in the output waveform. Hence, the output will get the optimum power supply for the grid.

REFERENCES

- [1] R. Miller, and W. White, "Simulation of Electromechanical Interactions of Permanent-Magnet Direct-Drive Wind Turbines Using the FAST Aeroelastic Simulator," pp. 1–8, 2014.
- [2] Tan and S. Islam, "Optimum control strategies in energy conversion of PMSG wind turbine system without mechanical sensors," IEEE Transaction on Energy Conversion, vol. 19, pp. 392-9, June 2004
- [3] Eftichios Koutroulis, Kostas Kalaitzakis, "Design of a Maximum Power Tracking System for Wind-Energy-Conversion Applications Proceedings of the IEEE transactions on industrial electronics", vol. 53, no. 2, april 2006.
- [4] M. Chinchilla, "Control of permanent-magnet generators applied to variable-speed wind-energy systems connected to the grid," Energy Conversion, IEEE transactions vol. 21, no. March, pp. 130–135, 2006.
- [5] Jamal A. Baroudi, Venkata Dinavahi, Andrew M. Knight, "A review of power converter topologies for wind generators," J.A. Baroudi et al. Renewable Energy Science direct Elsevier (2007) 2369–2385.
- [6] R. Fadaeinedjad, "Simulation of a wind turbine with doubly fed induction generator by FAST and Simulink," IEEE Transactions on Energy conversion, vol. 23, no. 2, pp. 690–700, 2008.

- [7] B. Beltran, "High-order sliding-mode control of variable-speed wind turbines, IEEE Transaction on Industrial Electronics, vol. 56, no. 9, pp. 3314–3321, 2009.
- [8] S. Belakehal, H. Benalla, A. Bentounsi, "Power maximization control of small wind system using permanent magnet synchronous generator," *Revue des Energies* vol. 12, pp. 307–319, 2009.
- [9] Alejandro Rolan', Alvaro Luna, Gerardo Vazquez, Daniel Aguila "Modeling of a Variable Speed Wind Turbine with a Permanent Magnet Synchronous Generator IEEE International Symposium on Industrial Electronics" (ISIE 2009) Seoul Olympic Parktel, Seoul, Korea July 5-8, 2009.
- [10] Z. Inverter, S. M. Dehghan, S. Member, M. Mohamadian, "A New Variable-Speed Wind Energy Conversion System Using Permanent-Magnet Synchronous," the IEEE transactions on Energy conversion . vol. 24, no. 3, pp. 714–724, 2009.
- [11] R. Melicio , V.M.F. Mendes , J.P.S. Catalão "Power converter topologies for wind energy conversion systems: Integrated modeling, control strategy and performance simulation." *Journal Elsevier R. Melicio et al. / Renewable Energy Science direct Elsevier* (2010) 2165e2174. 10 April 2010.
- [12] M. Van Dessel, M. Gay, G. Deconinck, "Simulation of grid connected PM generator for wind turbines," 2010 IEEE Int. Symp. Industrial Electronics, pp. 1479–1484, Jul. 2010.
- [13] Yinan Cui, Hasan Shanechi, Mohammad Shahidehpour, "Investigation into Use of PMSG-based Wind Farm for Grid Support". IEEE transactions on regular papers 2011.
- [14] Mirza Mohd. Shadab, Abu Tariq ,M.A.Mallick, "Simulation And Control Of 20 Kw Grid Connected Wind System. Proceedings of the International Journal of Electrical And Electronics Engineering Research" (IJEEER) ISSN 2250-155X Vol. 3, Issue 3, Aug 2012, 275-284.
- [15] P. Bouchard, "A method of tracking maximum power points in variable speed wind energy conversion systems," 2012 in International Symposium on Power Electronics, Electrical Drives, Automation and Motion Power Electron.2012.
- [16] Faeka Khater and Alaa Omar. "A Review of Direct Driven PMSG for Wind Energy Systems. *Journal of Energy and Power Engineering*" 7 (2013) 1592-1603. *Journal of Energy and Power Engineering* david publishing. (2013) 1592-1603.
- [17] Hamid Shariatpanah, Roohollah Fadaeinedjad, Masood Rashidinejad, "A new model for PMSG-based wind turbine with yaw control IEEE transactions on energy conversion", vol. 28, no. 4, december 2013.
- [18] Mirza Mohd.Shadab, Abu Tariq 2012, "Performance analysis of permanent magnet synchronous generator connected with wind turbine". *Proceedings of the International Journal of Advanced Technology & Engineering Research (IJATER)* ISSN NO: 2250-3536 VOLUME 2, ISSUE 2, MAY 2013.
- [19] E. Mahersi, A. Khedher, M. F. Mimouni, "The Wind energy Conversion System Using PMSG Controlled by Vector Control and SMC Strategies," published in international journal of renewable energy research Vol.3, No.1, 2013 vol. 3, no. 1, 2013.
- [20] Natalia Angela Orlando, Marco Liserre, , Rosa Anna Mastromauro, M and Antonio Dell'Aquila. "A Survey of Control Issues in PMSG-Based Small Wind-Turbine Systems. *Proceedings of IEEE transactions on industrial*
- [21] D. Ahmed and a Ahmad, "An optimal design of coreless direct-drive axial flux permanent magnet generator for wind turbine," *J. Phys. Conf. Ser.*, vol. 439, p. 012039, Jun. 2013.
- [22] G. Revel, A. Leon, D. Alonso, and J. Moiola, "Dynamics and Stability Analysis of a Power System With a PMSG-Based Wind Farm Performing Ancillary Services," *IEEE transaction on* , pp. 1–12, 2014.
- [23] ION BOLDEA "Variable Speed Generators "The electrical Generator handbook Published in 2006 by CRC Press Taylor & Francis Group.
- [24] OLIMPO ANAYA-LARA, NICK JENKINS "Wind Energy Modulation and Control" John Wiley & Sons, Ltd 2009
- [27] MUKUND R PATEL "Wind and Solar Power System" CRC Press 2011 Edition.

